

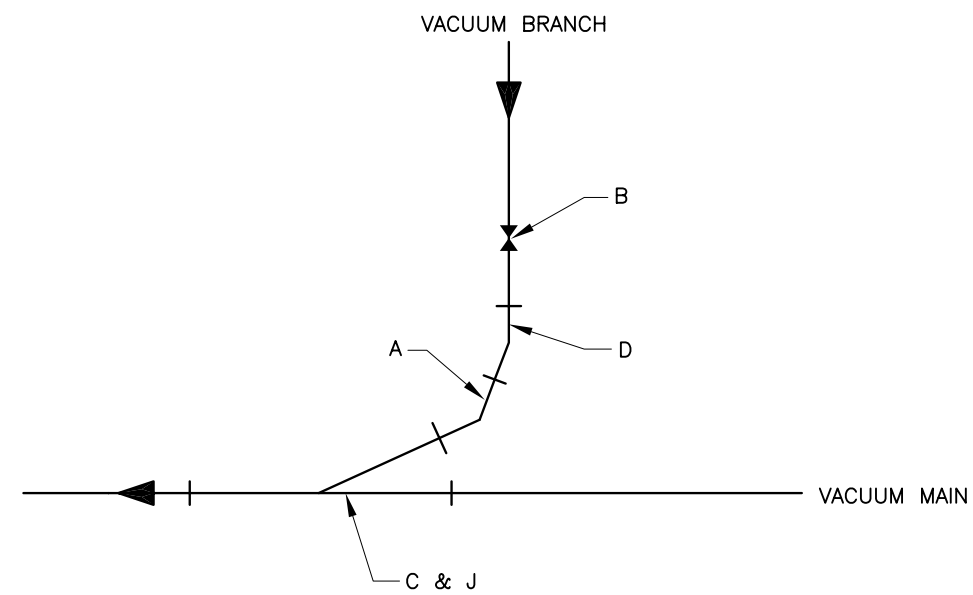


ALTERNATE "A"

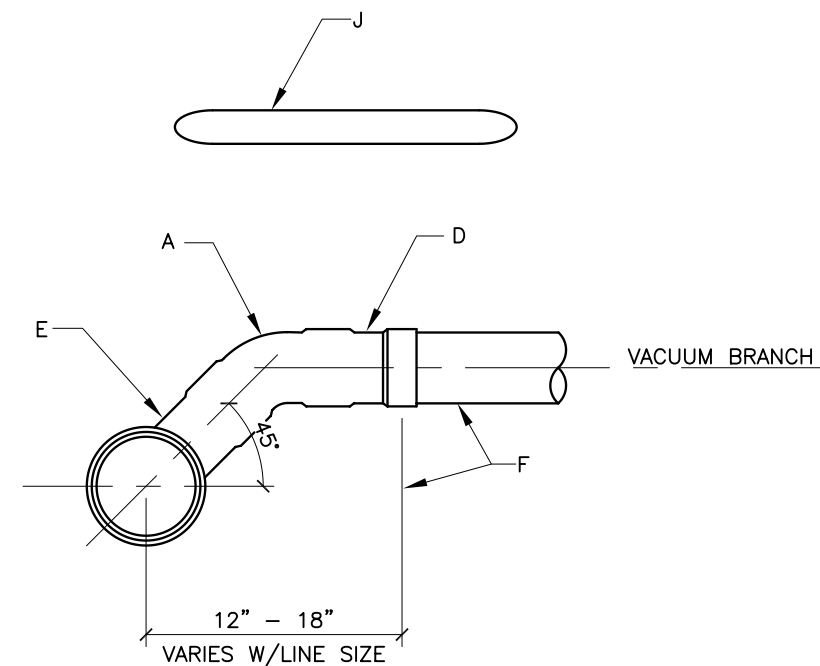

ALTERNATE "B"

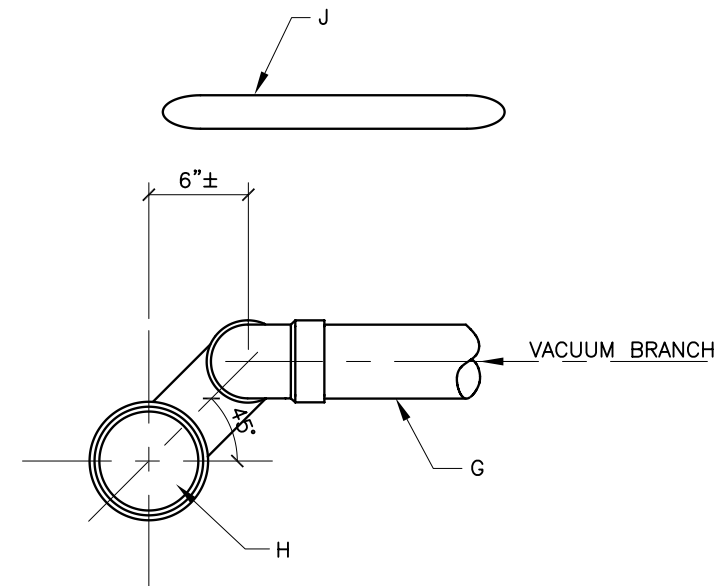

GENERAL NOTES:

1. UNLESS SHOWN ON CONSTRUCTION DRAWINGS, DIVISION VALVES WILL NOT BE INSTALLED FOR SERVICE CONNECTIONS.

CONSTRUCTION NOTES:

- A. 45° ELBOW.
- B. DIVISION VALVE AS SHOWN ON CONSTRUCTION DWGS.
- C. REDUCTION WYE @ 45°.
- D. 22 1/2° ELBOW.
- E. MAIN LINE WYE @ 45°.
- F. BOTTOM OF BRANCH IS AT TOP OF MAIN.
- G. BOTTOM OF BRANCH IS 1" - 2" ABOVE TOP OF MAIN.
- H. VACUUM MAIN
- J. ELECTRONIC MARKER DISK 12" ABOVE TOP OF PIPE.

REVISIONS	CITY OF ALBUQUERQUE
	VACUUM SEWER STANDARDS TYPICAL VACUUM BRANCH LINE CONNECTION
	DWG. 2164 JANUARY 2003